

LEAKAGE REDUCTION SOFTWARE DEVELOPED THROUGH THE WATER RESEARCH COMMISSION

by

RS McKENZIE ⁽¹⁾, J N BHAGWAN ⁽²⁾ and LAMBERT, AO ⁽³⁾

⁽¹⁾ WRP (Pty) Ltd, P O Box 1522, Brooklyn Square, 0075, ronniem@wrp.co.za

⁽²⁾ SA Water Research Commission, P O Box 824, Pretoria, 0001

⁽³⁾ IWDC Ltd, 3 Hillview Close, Llanrhos, North Wales, LL30-1SL- UK

ABSTRACT

Within the last few years there has been a growing realisation that the rapidly increasing water demands throughout South Africa are not sustainable. As a result of this realisation, there has been a significant change of emphasis away from the traditional approach of developing new water transfer schemes to one of Integrated Resource Planning in which water conservation is often regarded as a top priority. New legislation introduced by the South African government provides real incentives for better water use efficiency (or penalties for inefficient use) and will gradually result in stricter control of Non-Revenue Water throughout the country.

In order to support the government legislation and encourage efficient use of the available water resources in South Africa, the Water Research Commission (WRC) has initiated and supported numerous projects over the past 6 years. Although some very comprehensive and sophisticated software is already available both internationally and locally, it is often outwith the reach of many of the smaller water suppliers who cannot afford to purchase such packages. The WRC has therefore concentrated on providing low cost software solutions to assist water suppliers in understanding and managing their Non-Revenue Water. The following four models were developed and are now available free of charge through the South African Water Research Commission:

- SANFLOW - Logging and analysis of minimum night flows;
- BENCHLEAK - Water auditing and benchmarking of leakage;
- ECONOLEAK - Economics of leakage;
- PRESMAC - Pressure management.

The remainder of this paper provides details of the four models and their use in assisting water suppliers in understanding and managing their leakage.

INTRODUCTION

Within the last few years there has been a growing realisation that the rapidly increasing water demands throughout South Africa are not sustainable. As a result of this realisation, there has been a significant change of emphasis away from the traditional approach of developing new water transfer schemes to one of Integrated Resource Planning in which water conservation is often regarded as a top priority. New supply schemes are not excluded from future planning, but they will now be developed only in cases where it can be shown that the existing water resources are being used efficiently. Several recent studies have shown that major proposed augmentation schemes can be postponed by many years if the growth in demand can be trimmed by only a few percent – a target that is certainly achievable in most systems. The savings associated with delaying a new water transfer scheme are so large that the measures needed to achieve the delay are not only environmentally attractive but also very cost effective.

New legislation introduced by the South African government provides real incentives for more efficient water use (or penalties for inefficient use) and will gradually result in stricter control of Non-Revenue Water throughout the country.

In order to support the government legislation and encourage efficient use of the available water resources in South Africa, the Water Research Commission (WRC) has initiated and supported numerous projects over the past 6 years. Although some very comprehensive and sophisticated software is already available both internationally and locally, it is often out of reach of many of the smaller municipalities who cannot afford to purchase such packages. The WRC has therefore concentrated on providing low cost software solutions to assist water suppliers in understanding and managing their Non-Revenue Water.

The new models are all based on the Burst and Background Estimate (BABE) component analysis methodology which was first developed for the UK Water Industry in the early 1990's (Lambert et al, 1994). The BABE philosophy has since been accepted and adopted in many parts of the world as it provides a simple and pragmatic approach to the very complex and often confusing problem of leakage from water distribution systems. The approach was so successful that it is increasingly being recommended by international organisations as the most systematic and pragmatic approach to Leakage Management.

The BABE approach was first introduced to South Africa in 1994 through a series of courses and seminars presented countrywide by Ronnie Mckenzie and Allan Lambert (founder of BABE) at the request of the Water Research Commission. The methodology and concepts have since been widely accepted by most water suppliers throughout the country and have been incorporated to a large degree in the Code of Practice for the management of potable water in distribution systems (SABS, 1999).

The BABE concepts are most effective when applied in conjunction with the following:

- Fixed Area Variable Area Discharges (FAVAD) principles (May, 1994);
- Unavoidable Annual Real Losses (UARL) principles and
- The Infrastructure Leakage Index (ILI) from Lambert et. al., 1999.

In the development of the BABE techniques, it was initially agreed that the following four main elements of leakage management (see **Figure 1**) should be addressed:

- Logging and analysis of Minimum Night Flows;
- Economics of leakage and leakage control;
- Pressure Management;
- Benchmarking of Leakage and Auditing of Non-Revenue Water

In order to address the four key components of the BABE methodology, four models were developed over a period of approximately four years as shown in **Figure 2** and described in **Table 1**. Each model is a small self-contained program that addresses one specific issue. It was decided to adopt this simple and straightforward approach in order to avoid confusion and allow water suppliers to use one or all of the models as they consider appropriate rather than develop a single application covering all aspects.

All four models are available through the Water Research and details of the models are provided in **Table 1** for reference purposes. The various manuals accompanying the software can be obtained directly from the WRC website on www.wrc.org.za.

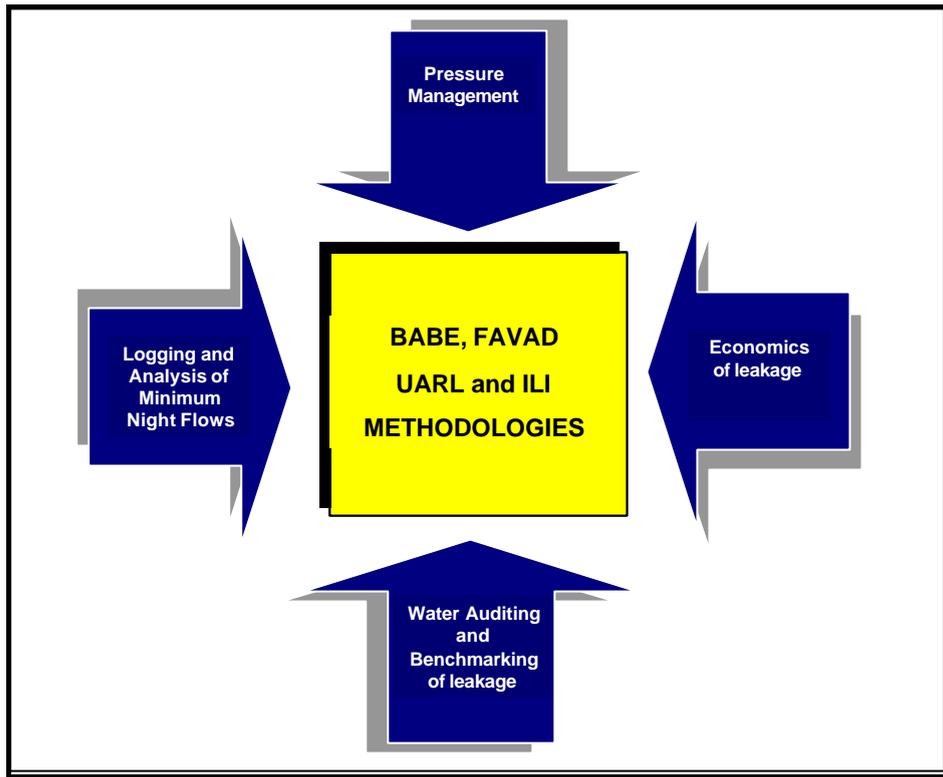


Figure 1: Four Main Elements of the BABE Methodology

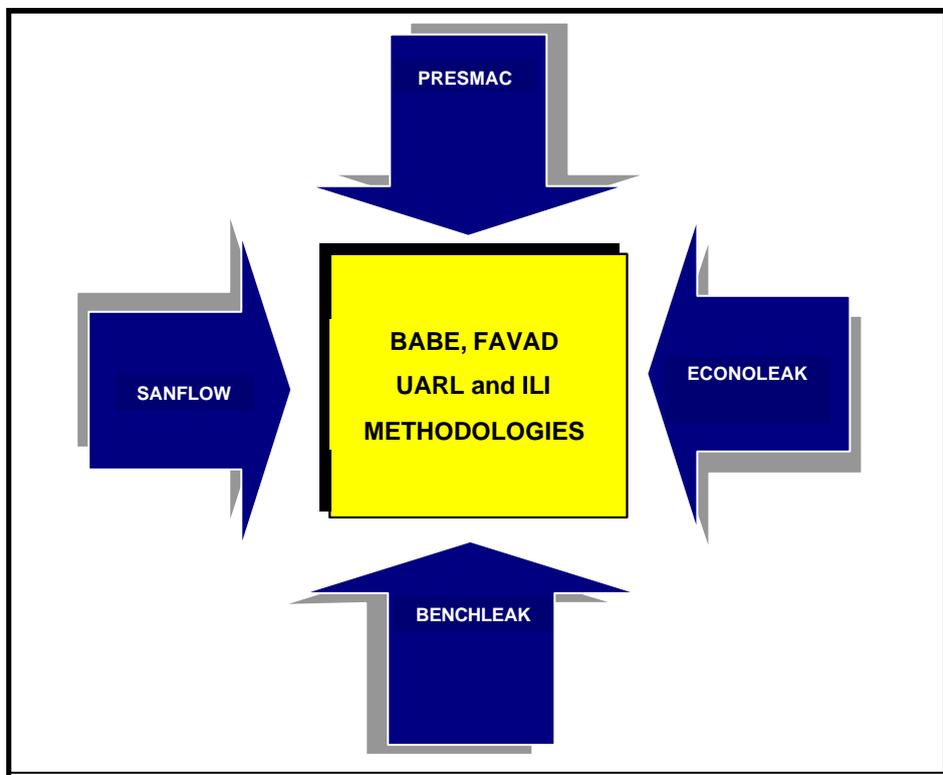


Figure 2 : Models Developed through the WRC

Table 1: Details of the various WRC BABE-based models

Model	Details	ISBN Reference	WRC Reference	Released
SANFLOW	Model designed to provide an indication of the unexpected detectable leakage in a zone from the analysis of the minimum night flow.	1 86845 490 8	TT 109/99	1999
PRESMAC	Model designed to estimate the potential for Pressure Management in a pressure zone based on logged flow and pressures over a representative 24-hour period.	1 86845 772 2	TT 152/01	2001
BENCHLEAK	Model designed to establish the components of non-revenue water in a water utility or zone metered area and associated performance indicators based on the latest IWA Task Force recommendations.	1 86845 773 7	TT 159/01	2001
ECONOLEAK	Model to evaluate the most appropriate frequency for undertaking Active Leakage Control	1 86845 832 6	TT 169/02	2002

It should be noted that, while the methodologies mentioned above address certain key issues regarding the management of leakage and non-revenue water, they do not address the many social and environmental issues which are also very important. Water suppliers should therefore ensure that they consider both the social and environmental issues as well as the technical issues since the success of a project will depend on both sets of issues being addressed properly.

BENCHLEAK: CALCULATION AND RELIABLE BENCHMARKING OF LEAKAGE

In South Africa it has been very difficult to compare leakage levels and levels of non-revenue water from one system to another, due to the fact that the Water Suppliers tended to use their own definitions of Real Losses and Unaccounted-for Water etc. By adopting a standard approach to the water balance, it is now possible to compare results from different systems in a meaningful manner and also compare the results from South African water suppliers with those from other water suppliers worldwide. The terminology adopted is depicted in **Figure 3**.

One specific problem which surfaces regularly concerns the manner in which water suppliers express their levels of leakage. Although it is still common practice to express leakage as a percentage of the water supplied into a particular system or zone, this simple performance indicator can be very misleading.

To demonstrate the problems associated with percentage values, a very simple example can be used. In this example a distribution system experiences leakage of 10 000 m³/day. This system is analysed for a range of different consumers as shown in **Table 2** (Lambert et al., 1998).

From **Table 2** it can be clearly seen that although the real losses are identical in all cases, the percentage losses vary considerably.

A project was initiated by the WRC to look into the problem of comparing leakage levels in the various

supply systems throughout South Africa. A standardised approach to leakage benchmarking was developed through the project and incorporated in the BENCHLEAK Model.

The approach adopted in the benchmarking project was based upon the most recent work by the IWA Task Force on Water Losses (Lambert et al, 1999) and was developed by the authors in close co-operation with and support from Mr Lambert. The approach developed through the WRC has been very successful and has already been adapted for use in many other parts of the world. Numerous organisations have now developed their own versions of BENCHLEAK which they are using to provide first order estimates of the real losses and non-revenue water in their water supply systems.

Table 2: Example to demonstrate problems with percentage losses*

Per capita consumption (litres/head/day)	Daily consumption (m ³ /day)	Distribution losses (m ³ /day)	Distribution input (m ³ /day)	Percentage losses
25 (Standpipe)	6 250	10 000	16 250	62
50 (Jordan)	12 500	10 000	22 500	44
100 (Czech Rep)	25 000	10 000	35 000	27
150 (UK, France)	37 500	10 000	47 500	21
300 (Japan)	75 000	10 000	85 000	12
400 (USA)	100 000	10 000	110 000	9

Full details of the Benchmarking procedure are provided in various papers presented at international conferences. In summary, however, the basic approach includes the use of the relatively new Performance Indicator called the Infrastructure Leakage Index (Lambert, et.al, 1999) (ILI) which is a simple ratio of the current annual real losses (CARL) divided by the unavoidable annual real losses (UARL).

$$\text{ILI} = \text{CARL} / \text{UARL}$$

The unavoidable annual real losses (UARL) can be easily assessed for most systems as long as the number of connections, length of mains, location of customer meters and average operating pressure are known. Details of all the calculations are provided in the BENCHLEAK User Guide which is available from the WRC together with the model.

The BENCHLEAK Model the IWA standardised 'best practice' terminology to describe the basic elements making up the water balance for a water supply system.

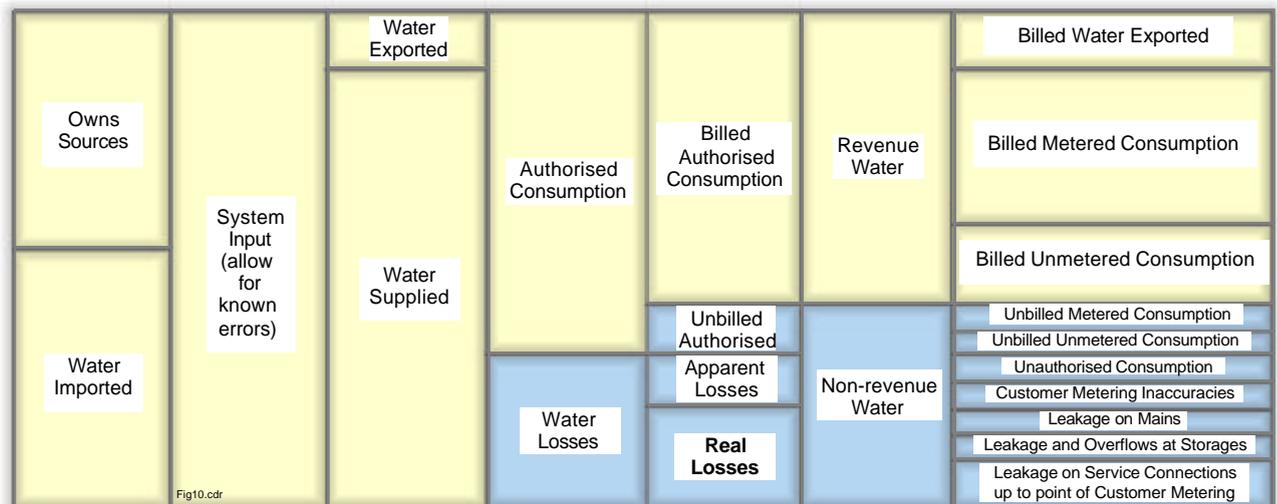


Figure 3: Main components of the water supply water balance

Full descriptions of all elements shown in **Figure 3** are provided in the BENCHLEAK User Guide (Mckenzie and Lambert, 2001) which is available together with the software from the WRC website.

Following the development of the BENCHLEAK Model, it was used to assess the annual volumes of non-revenue water and real losses in approximately 50 water supply systems throughout South Africa. The results were screened for errors and eventually the figures from 35 systems were documented in the WRC report.

It is interesting to note that the ILI values for the South African systems range from 1.0 to approximately 20, with an average value in the order of 7. This can be compared to ILI values calculated by the IWA Task Force for 27 supply systems in 19 countries which range from 1.0 to 10 with an average value of 4.2.

For South African conditions it would be unusual to achieve an ILI value of below 2.0. Values in the order of 5.0 are relatively common and represent systems in a reasonable condition.

While there is still some debate concerning the use of the ILI as a key performance indicator by certain water conservation specialists, the fact remains that it provides a useful system specific indication of the leakage problem in an area in a manner which can be easily understood, particularly in developing countries. While it may not be completely foolproof, it has been used with considerable success in identifying key problem areas in large reticulation systems and as far as the Clients are concerned that is exactly what they wish to achieve. At the end of the day, the results speak for themselves and until something better can be placed on the table, the ILI will be used to assist water suppliers to manage their leakage problems.

SANFLOW: BACKGROUND NIGHT FLOW ANALYSIS MODEL

Measurement of minimum night-flow into a zone-metered area (ZMA) is possibly one of the simplest and most valuable actions that a water supplier can take in order to identify whether or not they have a serious leakage problem.

A typical normal inflow to a ZMA is shown in **Figure 4** (UK Water Industry, 1994), from which the minimum night-flow can be identified as the lowest flow entering the zone at any time. In most zones the minimum night flow occurs sometime between midnight and 4 am. In order to evaluate the level of

leakage in a particular zone from the inflow, as shown in **Figure 4**, the minimum night-flow is split into various components (some of which are pressure dependent) in accordance with the general BABE principles. **Figure 5** shows the different components making up the minimum night-flow and these are fully explained in the SANFLOW user guide (Mckenzie, 1999).

The analysis of background night flows is comparatively simple and the SANFLOW software provides a quick and effective aid to water suppliers in this regard. The program was designed specifically to assist water suppliers in identifying likely problem areas with respect to leakage and conversely, also those areas that do not have a serious leakage problem.

The model is based directly on the BABE and FAVAD principles and is written in DELPHI for the Windows operating system. It includes several additional features which were not originally available on any of the overseas versions. In particular, it includes the ability to undertake sensitivity analyses based on basic risk management principles in order to provide a likely distribution for the number of bursts in a zone (or district). This feature enables the user to set an upper and lower limit on each parameter used in the model. The selection of the parameter values has often been criticised as too subjective, with the result that different users may obtain different results from the same initial data. By using the sensitivity analysis feature of the model, however, this potential problem can be addressed.

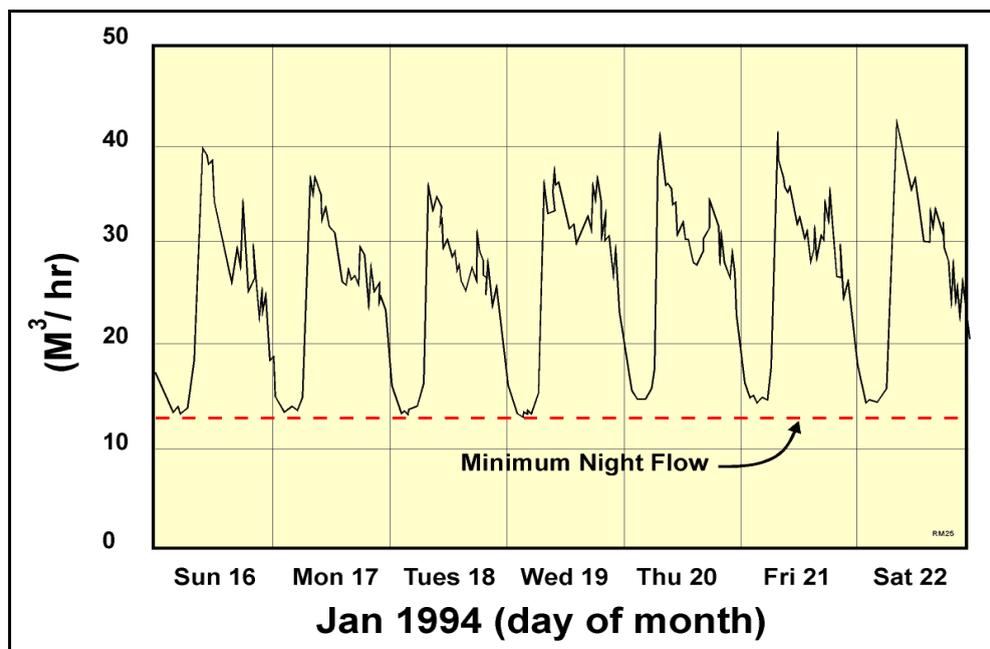


Figure 4: Example of inflow to a ZMA showing the minimum night flow

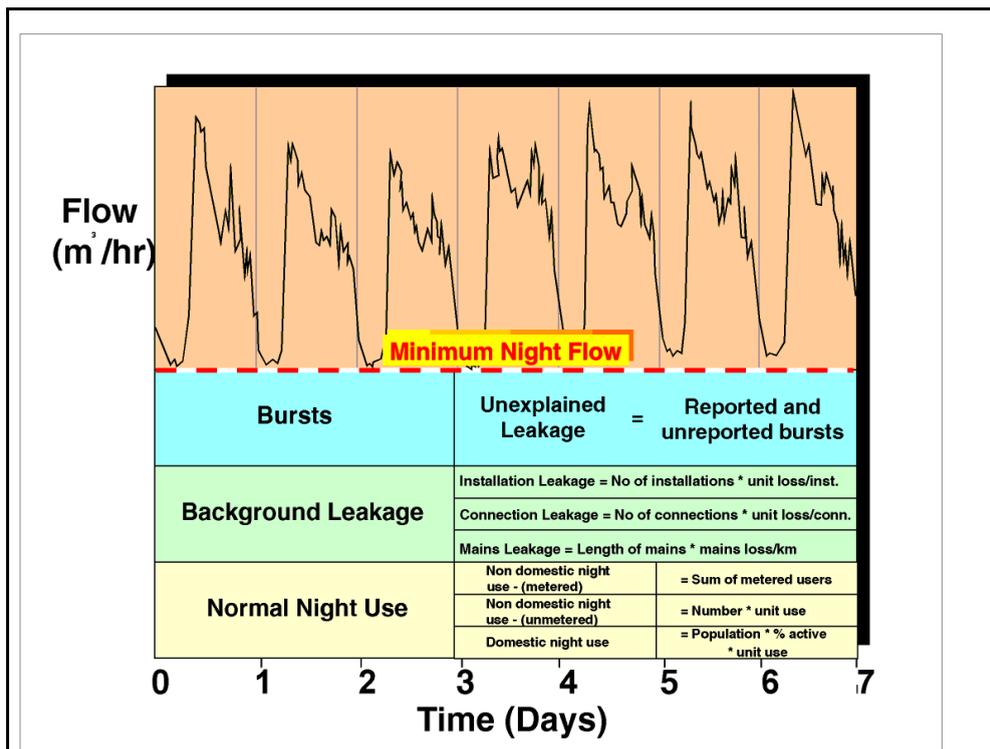


Figure 5: Components making up the minimum night-flow

It should be noted that the most recent versions of many BABE-based models now incorporate either sensitivity limits or error limits which help to provide the user with greater confidence in the results when using the models. It seems likely that all future models will be developed with this capability to address any concerns from users and water suppliers when using data which can be considered to be subjective in nature.

ECONOLEAK: ECONOMICS OF LEAKAGE MODEL

The economics of leakage control is becoming a very important issue since most water supply utilities in South Africa are operating on limited budgets. The water suppliers are often unable to provide proper motivation to carry out expensive rehabilitation or leak detection programmes. The approach used in the ECONOLEAK Model is one of several approaches which can be considered. It appears that there is no general consensus at present on the “standard” methodology to be applied to establish the economic level of leakage. The approach adopted may not address all issues regarding the economics of leakage. It does, however, help water suppliers to understand the various issues that should be considered and taken into account when attempting to establish the economic level of leakage for a particular water supply system. In this regard, it has proved to be very useful and helps to develop a better understanding of the economic issues among water suppliers throughout South Africa.

The new ECONOLEAK Model enables a water supplier to identify when it is necessary to intervene through active leakage control. In other words, the program will assist water suppliers in identifying when they should send a leak-detection and repair crew into an area to find unreported bursts. In order to use the model, the water supplier is required to gather the information indicated in **Table 3**.

Table 3: Basic information required in the ECONOLEAK Model.

Description	Units	Default
-------------	-------	---------

Number of service connections	Number	-
Length of transmission mains	km	-
Length of distribution mains	km	-
Average system pressure	m	-
Unavoidable connection losses at 50 m of pressure	Litres/connection/hr	1.25
Unavoidable mains losses at 50 m of pressure	Litres/km/hr	20
Leakage from service reservoirs	% of volume per day	0.1
Leakage through mains burst	m ³ /hr at 50m pressure	12.0
Leakage from connection pipe burst	m ³ /hr at 50m pressure	1.6
Average running time of mains burst	Days	0.5
Average running time of connection pipe burst	Days	10
Average cost of repairing mains burst	Rand	3 000
Average cost of repairing connection pipe burst	Rand	2 000
Monthly water supplied to the zone or district	Kilo litres	-
Estimated monthly real losses	Kilo litres	-
Purchase price of water from bulk supplier	Rand/m ³	
Selling price of water	Rand/m ³	
Service connection bursts per 1000 connections at 50 m of pressure	Bursts /1000 conn/yr	2.5
Annual frequency of mains bursts per km of mains at 50 m of pressure	No./km of mains/yr	0.15
Pressure leakage exponent for flow through mains and connection leaks	-	0.7
Power exponent for calculating number of mains leaks for different pressures (cubic relationship is normally adopted)	-	3
Cost of basic sounding per km of mains	Rand/km mains	700
Cost of leak noise correlator per km of mains	Rand/km mains	1400
% of mains requiring leak noise correlator to detect leaks	%	20

It should be noted, that if the information is not readily available from the water supplier's records, the default values provided in the User Guide can be used until more reliable information is obtained (Mckenzie, 2002).

The model uses the basic information described in **Table 3** to provide the water supplier with an indication of when they should intervene in a particular zone and also how much funding should be allocated to leakage detection and repair per annum.

PRESMAC: PRESSURE MANAGEMENT MODEL

In the continual battle to reduce leakage from potable water distribution systems, the influence of pressure is often overlooked. Potable water distribution systems are usually designed to provide a certain minimum level of service (usually in the order of 25 m of pressure in South Africa) throughout the day at the most critical point in the system. The critical point is generally either the highest point in the system or the point most distant from the source although it may be a combination of the two depending upon local topography.

The pressure at the critical point will depend upon the pressure at the inlet point minus the friction losses

occurring between the inlet and the critical point. The friction losses will be highest during periods of peak demand; typically during the breakfast period and again during the early evening period when most consumers are using water for washing, cooking, gardening etc. After the evening peak, the pressure throughout the system will gradually increase due to reduced friction losses and, in certain cases, also the filling up of local storage reservoirs.

Since the systems are designed to supply the minimum level of pressure at the critical point during the peak demand periods, it is clear that the pressure will increase during the periods of low demand. The pressures in potable water distribution systems are therefore significantly higher than required much of the time, particularly during the night when most of the consumers are asleep. Since losses and leakage from a system are highly dependant upon pressure, it is also clear that leakage rates will be highest during the periods when few, if any, consumers wish to use water.

Although there is no simple solution to the complex problem of excess pressure in a water distribution system, considerable research and development has taken place over the past decade. This has resulted in the creation of various techniques and equipment which can help to control pressure and thus reduce leakage.

Following the development of the Burst and Background Estimate (BABE) procedures in the early 1990's, various computer models were developed in the UK to assist water suppliers in assessing the reduction in leakage that could be achieved through various forms of Pressure Management. These software solutions were developed in parallel with several new pressure controllers that are able to modulate the pressure at a pressure reducing valve (PRV) according to time (time-modulation) or demand (flow-modulation). By using such controllers it became possible to reduce the pressure during periods of low demand and thus reduce leakage without adversely affecting the level of service to the consumers. For the first time, both software and hardware solutions could be used together to tackle pressure in potable water distribution systems.

Although the pressure management software developed in the UK is available commercially to any companies or consultants throughout the world, it is not designed specifically for South African conditions, nor is it supported by any organisation in South Africa. In addition, the UK software is relatively expensive in terms of the local currency and although the potential savings can be very significant, many of the smaller municipalities are unable to budget for such software without demonstrating the savings in advance – clearly a cart and horse situation.

To overcome these problems the WRC commissioned the development of a pressure management model (Mckenzie, 2001). PRESMAC is based on the same BABE and FAVAD principles as the existing UK models and was modified to suit South African conditions where necessary. The new South African model is a full Windows package written in DELPHI as opposed to the UK models which were originally based on EXCEL. The model can be used to assess the likely savings (in monetary terms) of various pressure reduction options (fixed outlet and time-modulated PRV's) in a selected zone metered area. The analysis is undertaken in a relatively simple and pragmatic manner allowing the user to gauge the potential for pressure management very quickly and effectively without requiring a full detailed pipe network analysis. Although the methodology is based on a number of simplifications and assumptions, in practice the predicted savings are generally within 10% to 20% of those actually achieved (erring on the conservative side).

Although the technology to implement Advanced Pressure Control is readily available and the concepts are well understood, limited legitimate results are currently available with the result that few South African water services providers have sufficient confidence to motivate and support the necessary capital investment.

To address the confidence issue, the Water Research Commission commissioned a study to undertake a series of Pilot Studies and to document the results. The pilot studies have since been documented (Wegelin et al., 2002) to provide information on Advanced Pressure Control so that water suppliers considering Pressure Management can evaluate the potential savings and associated problems. It is anticipated that the documented case studies will encourage water suppliers to consider the benefits of pressure management throughout the country.

When selecting the pilot areas, care was taken to select a range of different conditions so that the results were not simply weighted to the one or two extreme cases where massive savings can be achieved. Instead, the areas selected represent a fair cross-section of the type of areas that will be encountered in most water supply systems. Some of the areas are ideally suited to Advanced Pressure Control while others are not. The following eight pilot projects were eventually selected to illustrate the effects of pressure management in South Africa:

- City of Tshwane (Pretoria) – Valhalla high level zone;
- City of Tshwane (Pretoria) – Meintjieskop;
- Rand Water ODI – Slovoville (Mabopane);
- City of Johannesburg – Slovoville;
- City of Johannesburg – Tshepisoong;
- City of Tygerberg – Zone C (Khayelitsha);
- City of Oostenberg – Wallacedene;
- City of East London – Mdantsane PRV6.

The key findings from the Pilot Studies were summarised as follows:

- The average zone pressure for the eight selected zones was 58m, with minimum and maximum values of 13m and 102m respectively. This is higher than the international norm of approximately 45m (Lambert et al., 1999)
- Pressure reducing valves require regular maintenance and checking if they are to serve effectively in any water distribution system. Three of the existing seven PRV installations were not operational when the project commenced. This resulted in excessive zone pressures, high frequency of pipe bursts and high levels of leakage.
- Proper sizing of the meter and pressure-reducing valve should always be undertaken before any form of pressure management is implemented to ensure effective operation.
- The average minimum night flow to average daily demand relationship for the eight selected zones was found to be 66%, indicating very high levels of leakage in the pilot zones. A typical value of between 10% and 30% is expected for a well-managed system in the South African environment. Internationally the norm for a well-managed zone is even less. As mentioned previously, percentages can be misleading and the overall water use for the system must therefore be taken into consideration.

Some of the results from the Pilot Projects are summarised in **Tables 4 and 5**.

Table 4: Summary of inlet pressure and leakage reduction

Zone name	Inlet pressure (m) ⁽¹⁾			Minimum night flow (m ³ /h)			N1 value
	Before	After	Reduction	Before	After	Reduction	
Valhalla	45	36	9	14	11	3	2.5
Meintjieskop	80	70	10	63	53	10	1.0
Slovoville (ODI)	83	20	63	42	9	33	2.0
Slovoville (Jhb)	100	34	66	34	11	23	1.3
Tshepising	92	63	29	82	46	36	1.4
Wallacedene	47	20	27	83	52	31	1.0
Khayelitsha	44	21	23	321	180	141	0.8
Mdantsane	52	40	12	14	13	1	0.75
Average/Total	68	38	30	653	375	278	1.3

Notes: (1) Inlet pressure at time of minimum night flow

Table 5: Summary of reduction in zone inflow (m³/annum)

Zone name	Inflow without pressure management	Reduction in distribution losses	Reduction in consumption	Total reduction	Inflow with pressure management
Valhalla	592 395	6 903	368	7 271	585 124
Meintjieskop	1 307 795	24 317	827	25 145	1 282 650
Slovoville (ODI)	439 460	192 051	4 455	196 506	242 954
Slovoville (Jhb)	361 715	127 690	4 257	131 947	229 768
Tshepising	1 411 090	212 930	11 892	224 822	1 186 268
Wallacedene	1 133 453	58 832	2 101	60 934	1 072 519
Khayelitsha	3 295 220	202 864	-6 135	196 729	3 098 491
Mdantsane	191 625	4 698	81	4 780	186 845
Average	8 732 753	830 285	17 846	848 134	7 884 619

It should be noted that the results are based on actual logged flows and pressures and are therefore based on factual data. The reductions in leakage vary significantly from area to area and clearly highlight the message that pressure management can be very effective under certain conditions and relatively ineffective in other areas. It should also be noted that the Pilot Studies could not assess the influence of the pressure management activities on the burst frequency in the areas. In some cases the savings achieved from the reduction in the number of bursts can exceed the savings in current leakage. Unfortunately this could not be investigated due to the limited scope and budget for the study.

REFERENCES

Lambert et. al 1994. **The ‘Managing Leakage’ Series of Reports**

Report A : **Summary Report**. ISBN: 1 898920 06 0

Report B : **Reporting Comparative Leakage Performance**. ISBN: 1 898920 07 9

Report C : **Setting Economic Leakage Targets**. ISBN: 1 898920 08 7

Report D : **Estimating Unmeasured Water Delivered** ISBN: 1 898920 09 5

Report E : **Interpreting Measured Night Flows**. ISBN: 1 898920 10 9

Report F : **Using Night Flow Data**. ISBN: 1 898920 11 7

Report G: **Managing Water Pressure**. ISBN: 1 898920 12 5

Report H: **Dealing with Customers' Leakage**. ISBN: 1 898920 13 3

Report J: **Leakage Management Techniques, Technology and Training**. ISBN:1 898920 14 1

Lambert AO, 1997. **Pressure Management/Leakage Relationships: Theory, Concepts and Practical Applications**. Conference on Minimising Losses in Water Supply Systems, Apr. 1997. IQPC Ltd, London.

Lambert A, Brown TG, Takizawa M, Weimer D.,1999. **A review of performance indicators for real losses from water supply systems**. *AQUA.*, Dec 1999. ISSN 0003-7214

May J (1994) *Pressure Dependent Leakage*. World Water and Environmental Engineering, October 1994

Mckenzie, RS, 1999. **Development of a standardised approach to evaluate burst and background losses in potable water distribution systems : SANFLOW User Guide**. South African Water Research Commission, Report TT 109/99, ISBN 1-86845-490-8.

Mckenzie, R.S., 2001. **Development of a pragmatic approach to evaluate the potential savings from pressure management in potable water distribution systems - PRESMAC User Guide**. South African Water Research Commission, Report TT 152/01 ISBN 1-86845-772-2.

Mckenzie, R.S., 2002. **Development of a Windows based package for assessing appropriate levels of active leakage control in potable water distribution systems - ECONOLEAK User Guide**. South African Water Research Commission, TT 169/02, ISBN 1-86845-832-6.

Mckenzie, R.S., and Lambert A.O., 2001. **Development of a simple and pragmatic approach to benchmark real losses in potable water distribution systems - BENCHLEAK User Guide**. South African Water Research Commission, TT 159/01

ISBN 1-86845-773-7

SABS, 1999. **South African Code of Practice for the management of potable water in distribution systems**. SABS : 0306, 1999. ISBN 0-626-12046-2

Wegelin, W and Mckenzie, R.S., 2002. **Leakage Reduction through Pressure Management in South Africa : Concepts and Case Studies**. South African Water Research Commission, TT 186/02 ,ISBN 1-86845-878-2